


ITEM	DESCRIPTION	QUANTITY
1	EHT CABLE AS PER ZONE DRAWING	AS REQ'D
2	FIBERGLASS TAPE FOR SELF REGULATING CABLE AND STAINLESS STEEL TIE WIRE FOR PipeGuard CMH OR MI CABLE	AS REQ'D

ADDED CHART FOR FLANGE

PIPE SIZE (IN)	CABLE ALLOWANCE (mm)
1	150
1 1/2	300
2	500
3	600
4	600
6	700
8	800
10	900
12	1100
14	1200
16	1400
18	1700
20	1800
24	2100
30	2700

EXAMPLE 1

CABLE LENGTH = L1 + CABLE ALLOWANCE

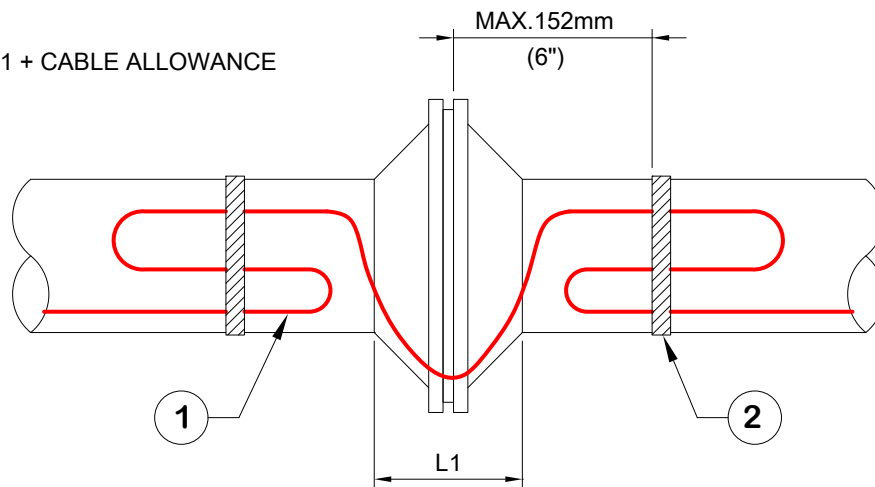

NOTES

- FOR INSTALLATIONS THAT REQUIRE MULTIPLE TRACES OF EHT CABLE, THE SPECIFIED CABLE ALLOWANCE IS REQUIRED FOR EACH TRACE.
- PROVIDE SUFFICIENT LENGTH ON TRACER LOOP TO ALLOW REMOVAL OF TRACER FROM FLANGE DURING MAINTENANCE. THE DETAIL ABOVE SHOWS THE GENERAL INSTALLATION METHOD. KEEP TRACE CLEAR OF FLANGE BOLTS AND NUTS.
- CABLE ALLOWANCES ARE IN ADDITION TO THE CENTER LINE LENGTH OF PIPING AND EQUIPMENT. (SEE EXAMPLE 1)

1	05/15/15	LOGO CHANGED	DRAWN EBC	<p align="center">INSTALL - FLANGES</p>	
			DATE 2011/03/19		
			CHECKED -		
			DATE -		
			ENGINEER -		
			DATE -		
			APPROVED -	SCALE NTS	DRAWING NO DWG003
			DATE -		REV 1
REV	DATE	REVISION			