


ITEM	DESCRIPTION	QUANTITY
1	EHT CABLE AS PER ZONE DRAWING	AS REQ'D
2	FIBERGLASS TAPE FOR SELF REGULATING CABLE	AS REQ'D

SHOE LENGTH (mm)	CABLE ADDED PER PASS (mm)	TOTAL LENGTH APPLIED (mm)
300 (12")	900 (36")	1200 (48")
450 (18")	1350 (54")	1800 (72")
600 (24")	1800 (72")	2400 (96")
750 (30")	2250 (90")	3000 (120")
900 (36")	2700 (108")	3600 (144")

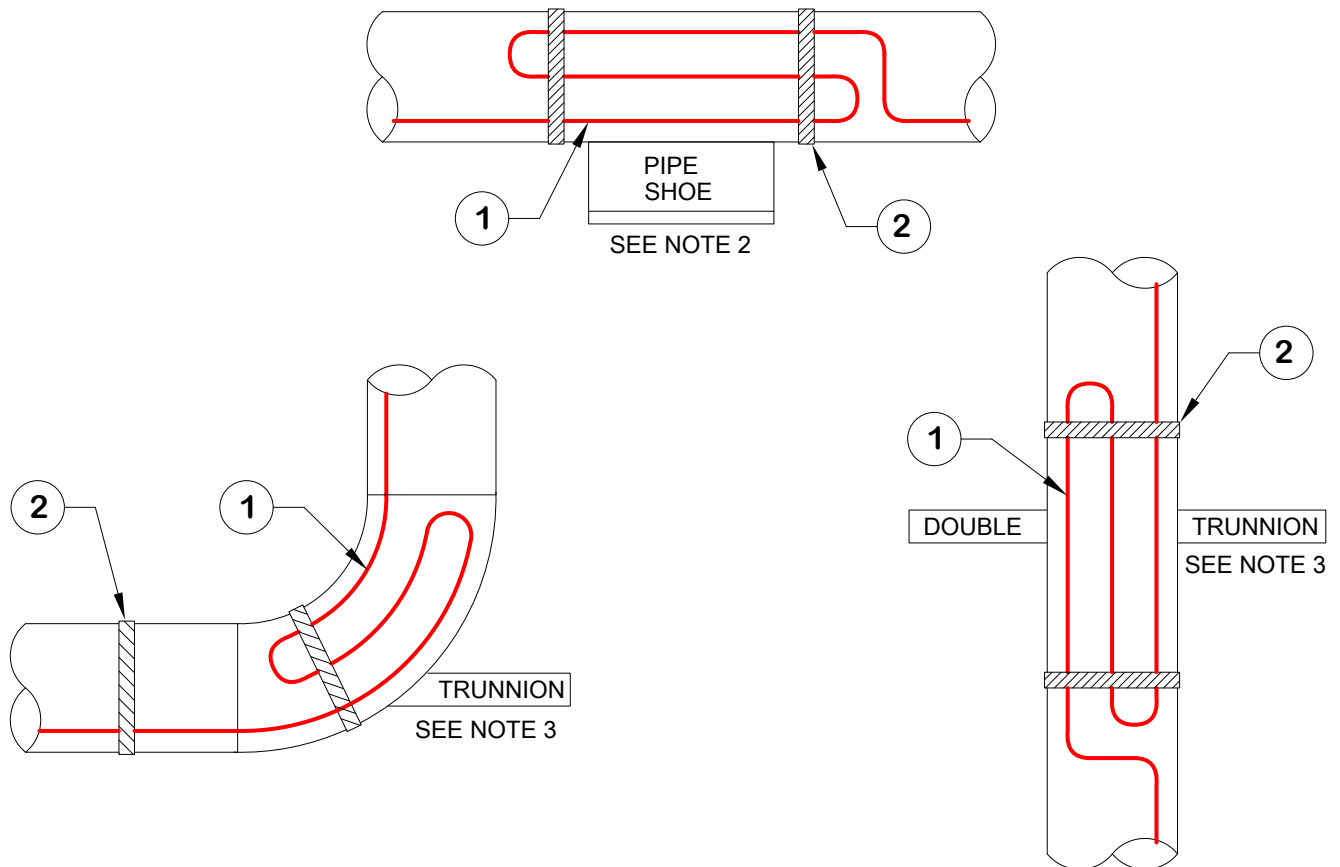

NOTES

1. A HEAT TRACE ALLOWANCE FOR PIPE SHOES, BASE SUPPORTS AND TRUNNIONS IS REQUIRED FOR PIPES SIZED FROM 50mm (2") TO 203mm (10"). PIPES SMALLER THAN 50mm AND LARGER THAN 203mm DO NOT REQUIRE ANY CABLE ALLOWANCE FOR PIPE SUPPORTS. WHERE REQUIRED, CABLE ALLOWANCES ARE IN ADDITION TO THE CENTER LINE LENGTH OF PIPING.
2. WHERE APPLICABLE (SEE NOTE 1) EACH PIPE SHOE SUPPORT SHALL BE PROVIDED WITH A HEAT TRACE ALLOWANCE EQUAL TO 3 TIMES THE LENGTH OF THE PIPE SHOE.
3. WHERE APPLICABLE (SEE NOTE 1) EACH BASE SUPPORT AND TRUNNION SHALL BE PROVIDED WITH A HEAT TRACE ALLOWANCE OF 1200mm (48").
4. FOR INSTALLATIONS THAT REQUIRE MULTIPLE TRACES OF EHT CABLE, THE SPECIFIED CABLE ALLOWANCE IS REQUIRED FOR EACH TRACE.

1	05/15/15	ITEM #2 DESCRIPTION CHANGED	DRAWN	EBC	TITLE	
1	05/15/15	LOGO CHANGED	DATE	2011/03/19	INSTALL - PIPE SUPPORTS	
			CHECKED	-		
			DATE	-		
			ENGINEER	-		
			DATE	-		
			APPROVED	-	SCALE	DRAWING NO
REV	DATE	REVISION	DATE	-	NTS	DWG005
						REV
						1

