


ITEM	DESCRIPTION	QUANTITY
1	SPLICED IN SECTION OF CMH CABLE	1
2	ENDS OF PREVIOUSLY INSTALLED CMH CABLE	2
3	PIPEGUARD CMH CABLE STRAIN RELIEF PN CMH-CON (DREX0074)	2
4	'C' TYPE METALLIC JUNCTION BOX OR OTHER APPROVED METALLIC ENCLOSURE	2
5	PIPE STRAP	2
6	PIPE INSULATION OUTER CLADDING	AS REQ'D

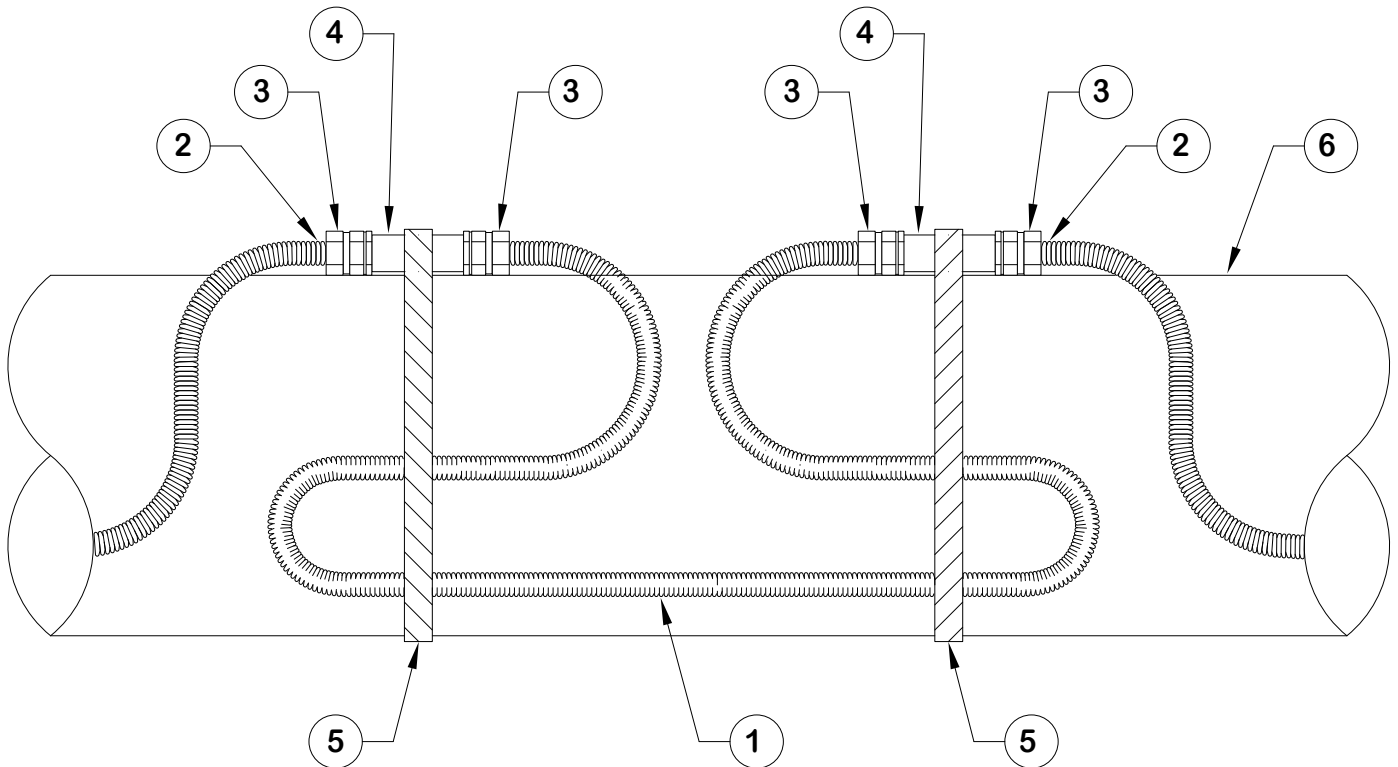

NOTES

1. CMH CABLE SPLICE IS INSTALLED OUTSIDE PIPE INSULATION AND CLADDING.
2. PIPE STRAPS (ITEM 5 ABOVE) ARE INSTALLED OVER THE PIPE INSULATION AND CLADDING.
3. REFER TO INSTALLATION INSTRUCTIONS FOR DREX0074 (CMH-CON)
4. WHERE MULTIPLE RUNS OR LOOPS OF A CONSTANT WATTAGE HEATER CABLE (SERIES MI AND PIPEGUARD CMH) ARE APPLIED TO PIPE SHOES AND SUPPORTS, CARE MUST BE TAKEN TO ENSURE THAT EXCESSIVE HEAT IS NOT GENERATED. DEPENDING IN PART UPON THE PIPE DIAMETER, IT MAY NOT BE NECESSARY TO INSTALL MULTIPLE RUNS OF CABLE AT A PIPE SHOE. CABLE WATTAGE OUTPUT MUST BE CONSIDERED. PLEASE REFER TO NOTE #1 ON INSTALLATION DRAWING 22.

1	04/16/14	STRAIN RELIEF PART REFERENCE CHANGED	DRAWN	EBC	TITLE	
2	05/15/15	LOGO CHANGED	DATE	2012/08/07	TYPICAL CMH SPLICE	
2	05/15/15	NOTE #4 ADDED	CHECKED	-		
2	05/15/15	ITEM #3 DESCRIPTION CHANGED	DATE	-		
			ENGINEER	-		
			DATE	-		
			APPROVED	-	SCALE	DRAWING NO
REV	DATE	REVISION	DATE	-	NTS	DWG020
						REV
						2

