

Installation Instructions

DREX0005AL

HP-PCT-2-AL

Metallic High Profile Power Connection Tee – Two Cables



These installation instructions are only for use with the following Drexan HeatTracer Self-Regulating heater products:

PipeGuard® Warm (PGW), MultiTrace® (MT), HotTape® (HT) and PipeGuard Hot (PGH).

This kit may be installed in temperatures as low as -40°F/°C.



WARNING: This is an electrical device and in order to ensure proper operation and prevent shock or fire it must be installed correctly. Read these important warnings. Follow all installation instructions.

CAUTION: Ground-fault equipment protection shall be provided to de-energize all normally ungrounded conductors of electrical heating cable sets, with ground fault settings sufficient to allow normal operation of the heater unless applicable codes permit otherwise, and to minimize the danger of fire from sustained electrical arcing if the heating cable is damaged or improperly installed and to comply with Drexan requirements, agency certifications and National Electrical codes. Conventional circuit breakers may not stop arcing. Each heating device branch circuit or each heating device shall have ground fault equipment protection.

Do not use substitute parts or substitute electrical tape. Component approvals and performance characteristics are based on Drexan specific parts only. Substitution will void warranty, approvals and performance claims.

The heating cable core is conductive and can short if not properly insulated and kept dry. Component and heating cable ends must be kept dry before and during installation. Fire-resistant thermal insulation materials should be used.

Heating cable core bus wires can overheat and short when damaged. When cutting the cable jacket or core do not break bus wire strands.

Bond the metallic braid of the self-regulating heating cable to a suitable grounding (earth) terminal. De-energize before installation or servicing.

HEATING CABLE RATINGS

120 – 277 Volt

PGH only: 5–20 W/ft., Maximum 40A.

Maximum intermittent exposure temperature 446°F/230°C.

Minimum bend radius: 1.72 in. (44 mm) @ -40°F/°C

All other cables: 3–10 W/ft., Maximum 32A.

Maximum continuous exposure temperature 150°F/65°C.

Minimum bend radius: 1.18 in. (30 mm) @ 68°F/20°C

Note: For installation in Class I, Div. 1 or Class II, Div. 1 areas, this kit must be used with kit DREX0019 (Division 1 Adapter Kit: Drexan Cat.# DIV1-ADP – supplied separately)

*APPROVALS



231572



E471335

**E484945



E471335

Class I, Div. 1/2, Groups A, B, C, D

Class II, Div. 1/2, Groups F, G

Class II, Div. 1, Group E

Class I, Div. 2, Groups A, B, C, D

Class II, Div. 2, Groups F, G

Class III

**General Purpose/Ordinary Location UL File

Class I, Groups B, C, D

Class II, Groups E, F, G

*This kit is not UL listed for use with PGH/HotTape products

© Drexan Energy Systems, Inc.
Kelowna, BC, Canada, V4V 1S5

KIT CONTENTS

- Metallic Conduit box with terminal block, cover, gasket and 4 plugs
- Metallic Strain Relief (cap, washer, grommet, base)
- Bracket with sealing ring, coupling and nipple
- Warning Label
- Insulated Crimp Sleeve
- (2) Cold applied Core Sealer
- (2) Pipe Straps
- Installation Instructions
- 3/16" tube (for PGW, MT, HT only)

REQUIRED BUT NOT PROVIDED

Materials

- Cable Lubricant
- Glass Fiber Cloth Tape, Drexan Cat. TAPE-GCR-HT / TAPE GCS-LT or equivalent

Note: For installation in Class I, Div. 1 or Class II, Div. 1 areas, this kit must be used with kit DREX0019 (Division 1 Adapter Kit: Drexan Cat.# DIV1-ADP – supplied separately)


Equipment

- Utility Knife
- Wire Stripper
- Wire Cutter
- Crimp Tool
- Multi-head Screwdriver
- Pipe Wrench
- Heat Gun


ASSEMBLY INSTRUCTION DETAILS

PIPEGUARD WARM (PGW) / MULTITRACE (MT) / HOTTAPE (HT)


1. Allow approximately 32" (81.3 cm) of heating cable for installation from the pipe.
2. Screw Nipple into Housing. Attach Rigid Coupling to the base of the Nipple.
3. Disassemble two Strain Reliefs and cut heaters on approximately a 45° angle. Lubricate heater with cable lubricant and thread heaters through Strain Relief cap, washer and grommet (wide end towards washer) respectively until 8" (20.3 cm) of the heater end is exposed. Put Strain Relief bases aside.

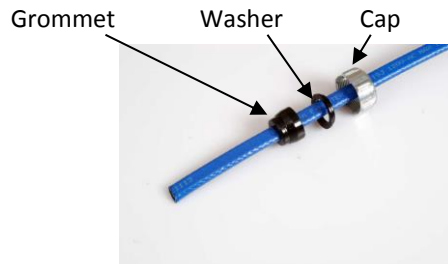

4. Taking care not to cut the Ground Braid, remove 7" (17.8 cm) of outer jacket from the Heater.

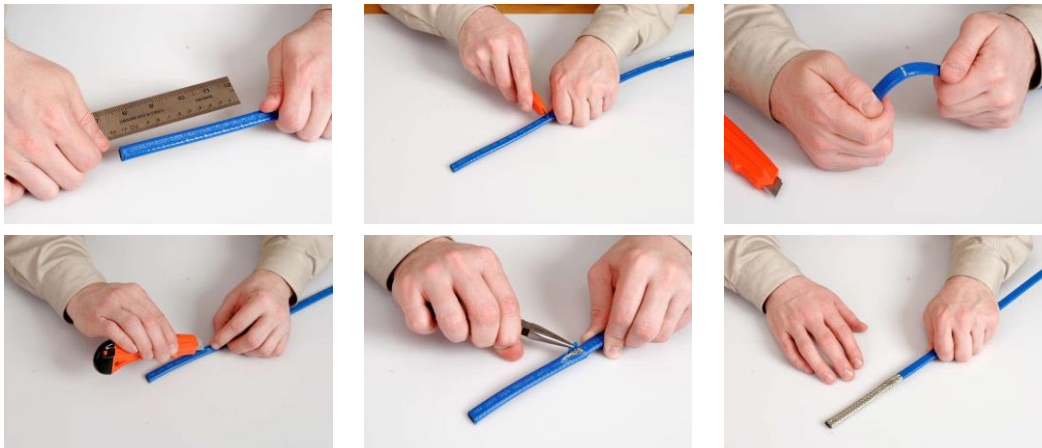


5. Push Ground Braid back towards the outer jacket cut-back. Make a buckle in the braid. With a screwdriver, create an opening in the Ground Braid without cutting it, big enough to pull the cable through. Bend cable enabling it to push through the opening in the Ground Braid. Twist the Ground Braid into a solid ground lead.

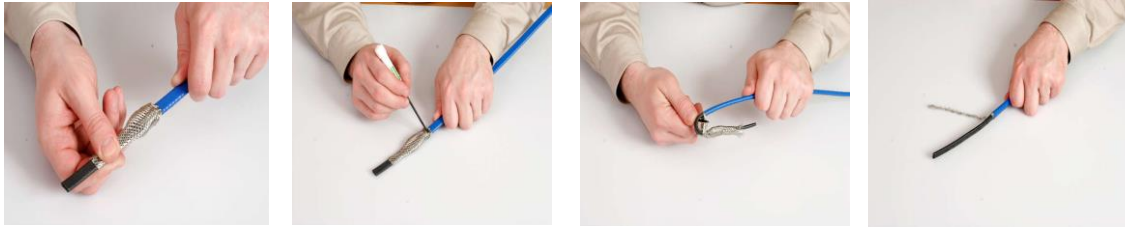

6. Strip back inner jacket and clear membrane within 1½” (38 mm) of the outer jacket cut-back.



7. Notch core. Peel one of the conductors from the core. Score core between the conductors as close as possible to cut-back end. Peel core from remaining conductor. Clean conductor wires until wires are completely exposed.

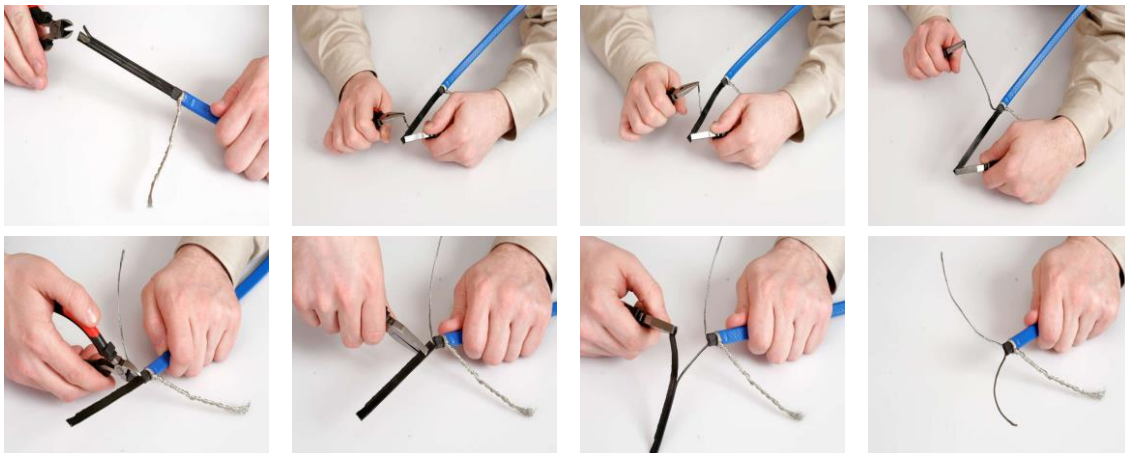


8. Place the supplied tube over one bus wire prior to sliding the core sealer over the bus wires (PGW / MT / HT only - this will provide added protection from a short between the two bus wires). Then slide the core sealer over the bus wires of the cable, over the inner core until as close to the braid as possible.

Note: ensure the crotch of the core sealer is tight up to the inner jacket separating the two bus wires.



PIPEGUARD HOT (PGH)

1. Allow approximately 24" (61 cm) of heating cable for installation from the pipe.
2. Disassemble the Strain Relief assembly, cut heater on approximately a 45° angle. Thread heater through Strain Relief cap, washer and grommet (wide end towards washer) respectively until 8" (20.3 cm) of the heaters end is exposed. Put Strain Relief base aside.

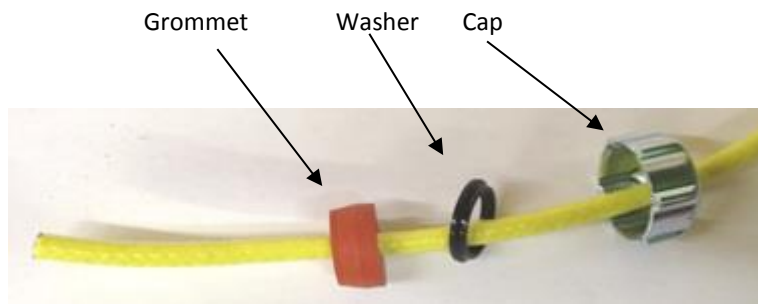

3. Taking care not to cut the Ground Braid, remove 7" (17.8 cm) of outer jacket from the Heater



4. Push Ground Braid back towards the outer jacket cut back. Make a buckle in the Braid. With a screw driver, create an opening in the Ground Braid without cutting it, big enough to pull the cable through. Bend cable enabling it to push through the opening in the Ground Braid. Twist the Ground Braid into a solid ground lead.
5. Strip back inner jacket to within 1½" (38 mm) of the outer jacket cut back exposing the bus wires. Trim the fiber heating element and spacer.




6. Slide the core sealer over the bus wires of the cable, over the inner core until as close to the Braid as possible.

Note: Ensure the crotch of the core sealer is tight up to the inner jacket separating the two bus wires.



FINAL ASSEMBLY

1. Assemble the Stand by placing it between the Rigid Coupling, Sealing Ring and the Strain Relief base. Tighten the Housing, Nipple, Rigid Coupling, Stand and Strain Relief base until all are snug using appropriate tools.

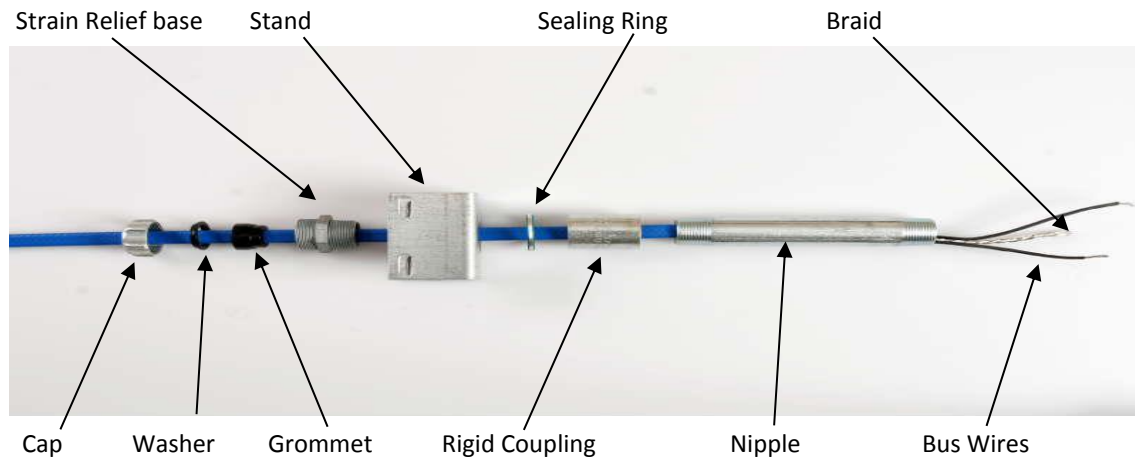

2. Feed the heater conductors and ground wire through the Strain Relief base up the Nipple and into the Housing. Fit the heater Strain Relief Grommet into the Strain Relief base. Hand-tighten the Strain Relief Nut and Washer.
3. Locate an appropriate hole for the Power Connection and bring power to the box.

Note: The illustrations shown in this installation instructions document illustrate the use of flexible cord and cord connectors for supply power field wiring which is not an acceptable wiring method in hazardous locations. For installation in hazardous locations, the wiring method used shall comply with one of the wiring methods permitted in the National Electrical Code or Canadian Electrical Code (as applicable) for the hazardous location classification of the installation.

4. Install Plugs into remaining holes in Housing (see photo at right).
5. Insert Ground wires into the (Green Yellow) Ground Terminal Block by pushing Terminal Blocks open with a Screwdriver. Remove the Screwdriver to make the connection.
6. Insert Power conductors into the Terminal Block by pushing Terminal Blocks open with a Screwdriver. Remove the Screwdriver to make the connection. Ensure that the Conductor is not visible and pull-test the connection.
7. Insert heater conductors into the Terminal Block by pushing Terminal Blocks open with a Screwdriver. Remove the Screwdriver to make the connection. Ensure that the conductor is not visible and pull-test the connection.
8. Retighten Strain Relief Nuts ($\frac{1}{4}$ turn) with a wrench.
9. Install lid on Housing making sure not to pinch conductors.
10. Attach to the pipe using SS Straps through the pipe bracket ensuring pipe straps are underneath cable, not over top.
11. Find a suitable location and affix the Electrical Warning Label. The presence of the trace heaters shall be made evident by the posting of caution signs or markings at appropriate locations and/or at frequent intervals along the circuit.

