

AMIGA-E



DREX0080

INSTALLATION INSTRUCTIONS

These installation instructions are for use with Drexan Energy Systems PipeGuard® Hot (PGH), PipeGuard Warm (PGW) and MultiTrace® (MT) self-regulating heater products. This kit may be installed in temperatures as low as -40°F (-40°C).

For technical support call Drexan at
1.800.663.6873



HD190411-1 Rev0

Warnings

This is an electrical device and in order to ensure proper operation and prevent shock or fire it must be installed correctly. Read these important warnings. Follow all installation instructions.

CAUTION: Ground-fault equipment protection shall be provided to de-energize all normally ungrounded conductors of electrical heating cable sets, with ground fault settings sufficient to allow normal operation of the heater unless applicable codes permit otherwise, and to minimize the danger of fire from sustained electrical arcing if the heating cable

is damaged or improperly installed and to comply with Drexan requirements, agency certifications and national electrical codes. Conventional circuit breakers may not stop arcing. Each heating device branch circuit or each heating device shall have ground fault equipment protection.

Metallic structures or materials such as metal pipes used to support the heater cable shall be grounded.

Component approvals and performance characteristics are based on Drexan specific parts only. Maximum surface temperature: +260°C (500°F)*.

*Applies to PGH product only

Substitution will void approvals and performance claims.

Component and heating cable ends must be kept dry before and during installation. Fire resistant thermal insulation should be used. Bond the metallic braid of the self-regulating heating cable to a suitable grounding (earth) terminal. De-energize before installation or servicing.



WARNING - EXPLOSION HAZARD - DO NOT DISCONNECT EQUIPMENT UNLESS POWER HAS BEEN SWITCHED OFF OR THE AREA IS KNOWN TO BE NON- HAZARDOUS.



AVERTISSEMENT - RISQUE D'EXPLOSION - AVANT DE DECONNECTER L'EQUIPEMENT, COUPER LE COURANT OU S'ASSURER QUE L'EMPLACEMENT EST DESIGNÉ NON DANGEREUX.

Approvals



Class I, Div. 2, Groups A, B, C, D
Class II, Div. 2, Groups F, G
Class III

For use with Drexan HeatTracer PipeGuard Heating Cables only.

CAUTION: A ground fault protection device must be used with this heating device.

T-rating: Classified to rated output and conditions of use/limited pipe temperature.

Cable-Specific Specifications

PGH only:

5-20 W/ft., Maximum 40A. 120-277V

Maximum intermittent exposure temperature
446°F/230°C.

Min. bend radius: 1.72 in. (44 mm) @ -40°F/°C

PGW/MT Only:

3-10 W/ft., Maximum 32A. 120-277V


Maximum continuous exposure temperature
150°F/65°C.

Min. bend radius: 1.18 in. (30 mm) @ 68°F/20°C

AMIGA-E Kit Contents



Item	Qty	Description
1	1	Stanchion
2	1	End Seal Cap
3	1	Silicon Grommet
4	1	Cable Guide
5	1	Connector
6	1	Boot
7	1	Ground Assembly
8	1	Pipe Clamp
9	1	Cable Tie




Cable Tie

Additional Materials Required



Knife

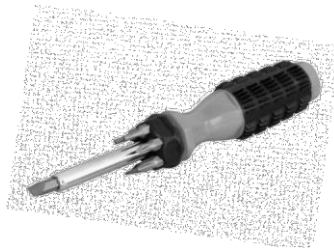

Multi Head Screw Driver




Glass Fiber Tape


Installation Instructions

Cut cable at 45° angle to pierce grommet.

1. Allow min. 9" (230 mm) for cable term. and min. 12" (305 mm) for the service loop.

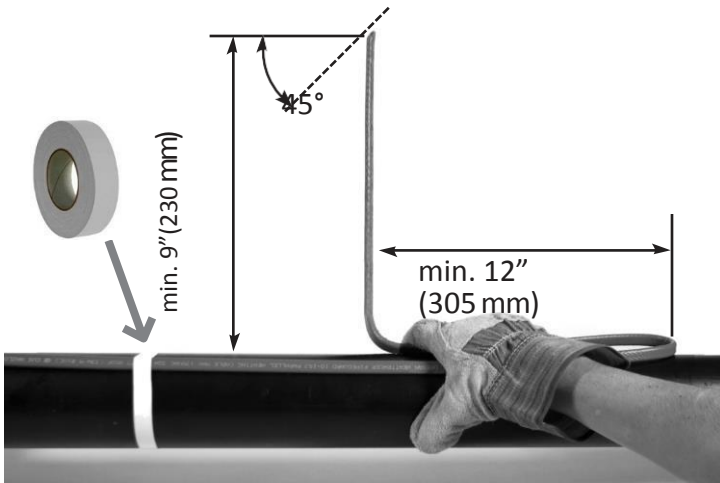

4. Attach stanchion with pipe clamps. **Do not tighten clamps onto cable.**

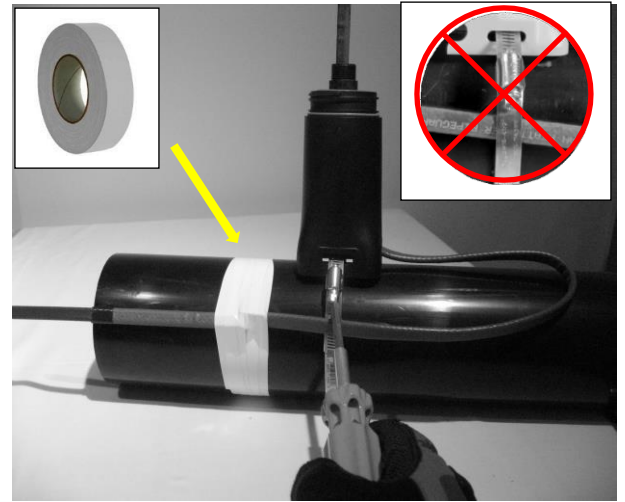


2. Ensure the shoulder of the connector is flush with stanchion.

shoulder




5. Ensure at least 4" (102 mm) remains for cable termination.

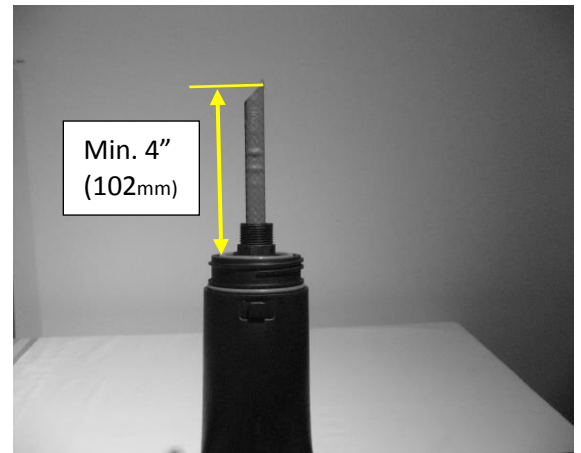

3. Feed the cable through the stanchion, piercing the grommet membrane.




6. Tighten the connector until it bottoms out.

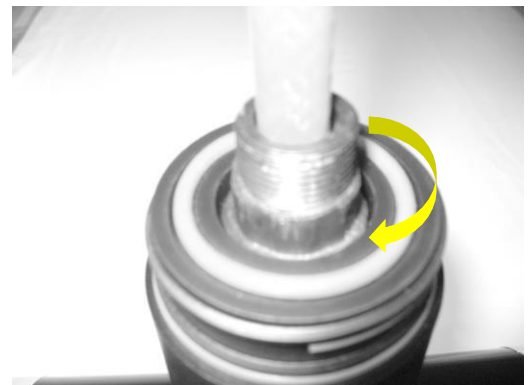

Installation Instructions


- 7.** Thread the ground nut onto the connector and tighten

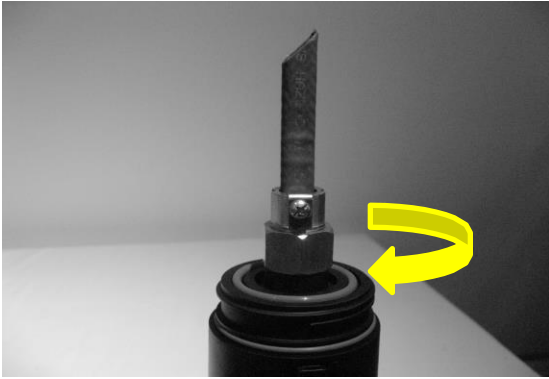


- 8.** Tighten the ground screw to secure the cable.




- 9.** Square off the end of the cable 3" (76mm) above the stanchion.

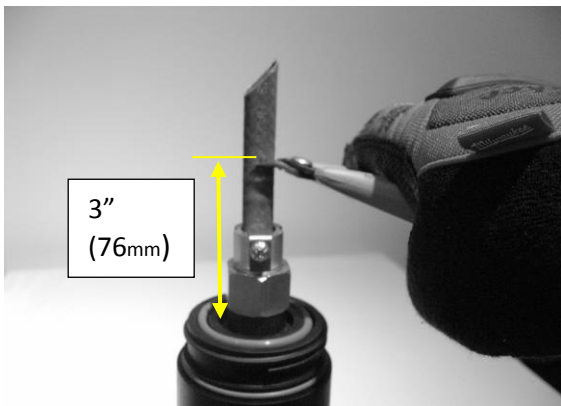


- 10.** Trim / remove the outer jacket and ground braid 0.5" (13 mm) from the end of the cable.

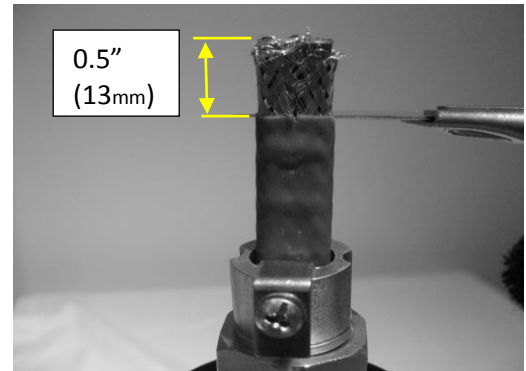

- 11.** Slide the Silicon Boot over the end of the cable. Ensure the lower o-ring is in place.

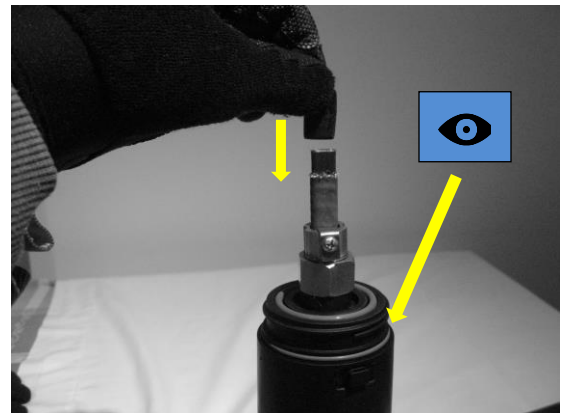

- 12.** Thread the End Seal Cap onto the Stanchion.

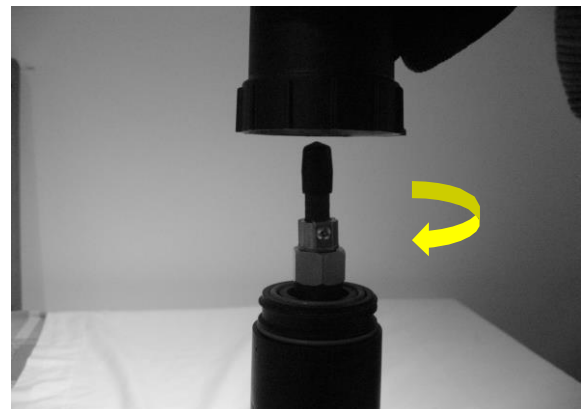

Installation Instructions

13. Install the Cable Tie (supplied) to secure the End Seal Cap to the Stanchion. Trim to length as necessary.

